

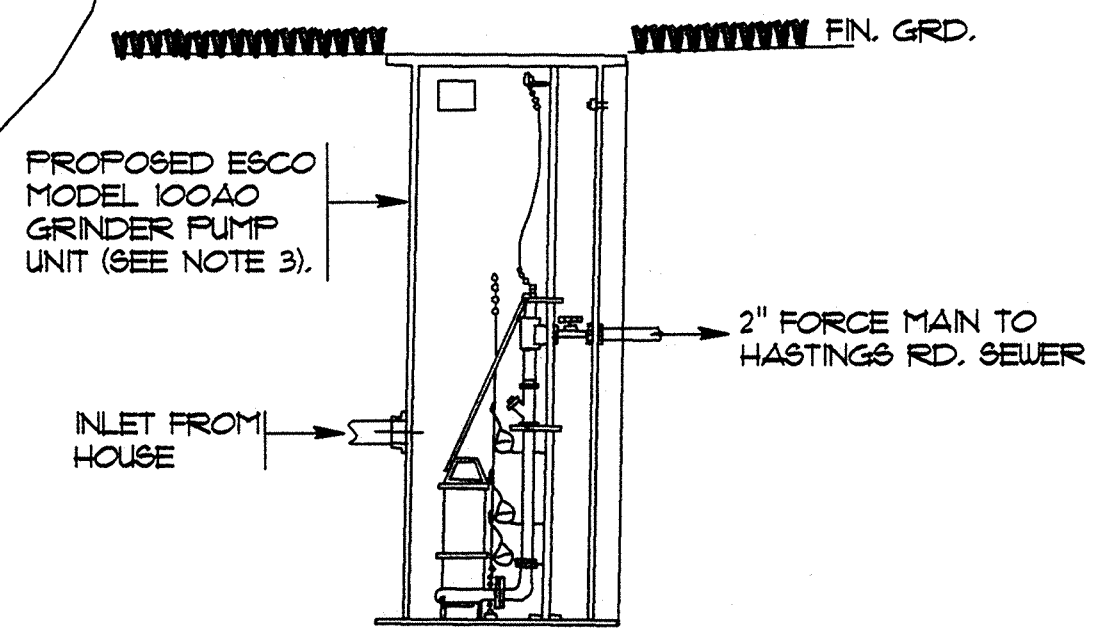


NOTES:

1. THIS PLAN IS NOT THE RESULT OF AN INSTRUMENT SURVEY, RATHER IS A COMPILATION OF PLANS OF RECORD.
2. ABANDON EXISTING CESSPOOL BY PUMPING THE CONTENTS AND FILLING WITH SAND.
3. PROPOSED GRINDER PUMP UNIT TO BE "ESCO MODEL 100AO SINGLE GRINDER UNIT" AS MANUFACTURED BY ENGINEERED SPECIALTIES CORP., PO BOX 4936, EAST PROVIDENCE, RHODE ISLAND
4. PUMPS TO BE MODEL 32DGU61.5S AS MANUFACTURED BY EBARA OR APPROVED EQUAL.
5. FORCE MAIN TO BE 2" PVC AND SHALL BE INSTALLED AT A MINIMUM DEPTH OF FOUR FEET (4').

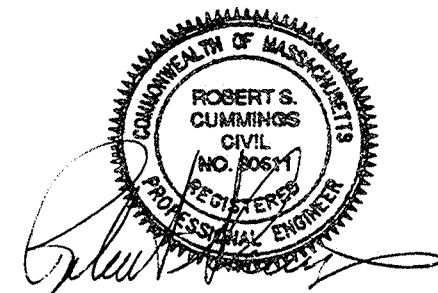

DETAIL OF GRINDER PUMP UNIT INSTALLATION
NOT TO SCALE

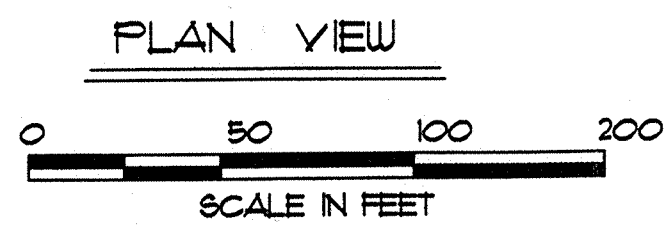

PLAN OF SEWER CONNECTION
<p>ANDREW J. SANTOS 32 HASTINGS ROAD MARION, MASSACHUSETTS</p>
<p>East Coast Engineering, INC. P.O. Box 745 56A Front Street Marion, MA 02738 (508) 748-2460 Fax (508) 748-2888</p>